


# Water Meter Relocation / Modification Application 2025/2026

**PRIVACY COLLECTION NOTICE:** South Burnett Regional Council collects your personal information for the purpose of processing this form and for use in any Council matters. Your personal information is handled in accordance with the *Information Privacy Act 2009* and will only be disclosed to a third party as per the South Burnett Regional Council Information Privacy Policy. **A hard copy of this electronic document is considered uncontrolled when printed.**

<b>Applicant details</b>			
Applicant (Business Name if applicable)			
Full name		Contact phone	
Contact email			
Postal address			
Site address			
Lot number		Registered plan number	
<b>Connect is for?</b>			
<input type="checkbox"/> Single dwelling	<input type="checkbox"/> Multiple dwelling	<input type="checkbox"/> Commercial dwelling	<input type="checkbox"/> Other
Sketch details of proposed new location of water meter (if required)			
<b>Details of service required</b>			*GST is not applicable
<input type="checkbox"/> Meter relocated in line with current connection to the main <input type="checkbox"/> Meter relocated to different position on the property involving a new connection to the main <input type="checkbox"/> Meter lowered (meter box included) <input type="checkbox"/> Other (please specify)			Forward completed form to Council for quotation  \$134.00
<input type="checkbox"/> Meter box supplied and fitted to existing meter <span style="font-size: 2em;">→</span>			
Applicant signature		Date	
<b>Office Use Only</b>			
Officer name		Date	
Amount received	\$	Receipt number	
Comments			

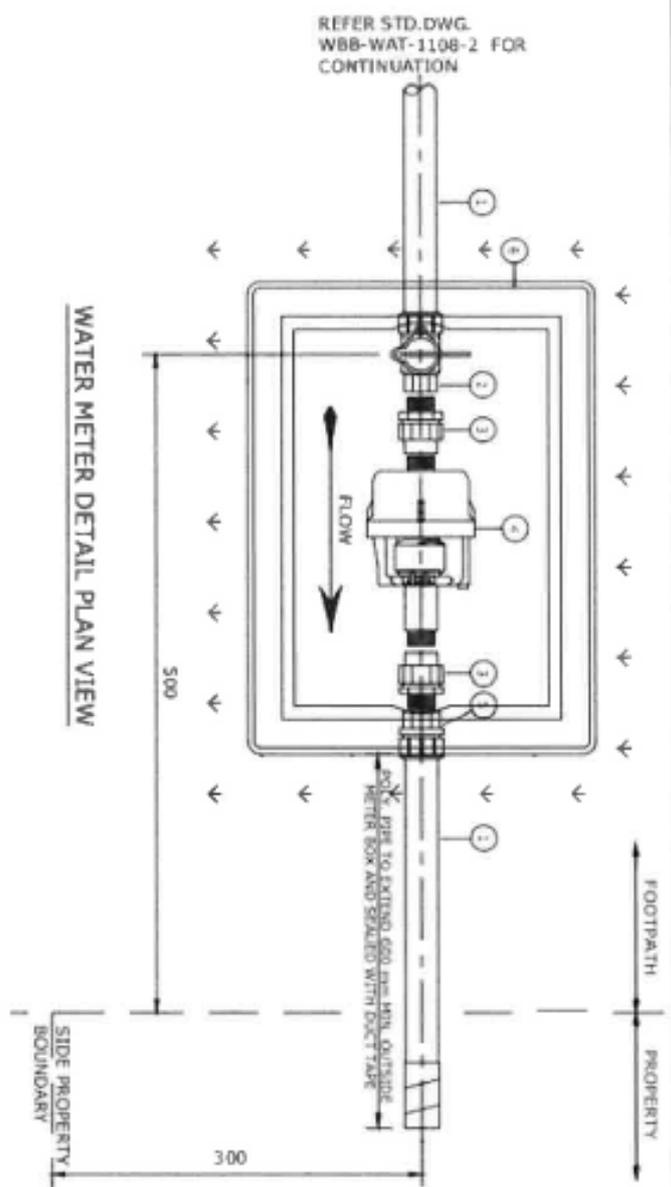


REFER STD.DWG.  
WBB-WAT-1108-2 FOR  
CONTINUATION

WATER METER DETAIL PLAN VIEW

**NOTES**

1. **DELETED.**
2. SERVICE PIPEWORK SHALL BE DN25 PE100 PN16 BLACK POLYETHYLENE PIPE WITH BLUE STRIPE IN ACCORDANCE WITH AS/NZS 4130.
3. ALL CONNECTIONS TO POLYETHYLENE PIPE TO BE APPROVED BRASS OR PLASTIC MECHANICAL FITTINGS.
4. ALL WATER INSTALLATIONS TO BE CARRIED OUT BY A LICENSED PLUMBER AND TO BE IN ACCORDANCE WITH RELEVANT BY-LAWS OF PLUMBING AND DRAINAGE ACT.
5. ALL PLUMBING FITTINGS TO BE GUNMETAL OR BRASS - DEZINCIFIED RESISTANT TO R AND APPROVED TO AS 3855.
6. ALL BRASS FITTINGS SHALL HAVE MAKERS NAME OR MARK AND WATERMARK IMPRINTED ON SURFACE OF FITTING TO PROVE COMPLIANCE WITH AS 3855. VALVES AT THE METER ARE TO BE LEFT IN THE CLOSED POSITION AFTER CONSTRUCTION.
7. WATER SERVICES ARE TO BE INSPECTED BY WBBROC-SP INSPECTOR PRIOR TO BACKFILL.
8. BALL VALVE, WATER METER AND METER BOX TO BE APPROVED.
9. METER BOX LID SHALL HAVE NON SLIP PATTERN, LETTERING CAST INTO LID INDICATING "WATER METER" AND BE BLACK IN COLOUR.
10. METER BOX LID TO BE LEFT SO THAT IT SITS FLUSH WITH TURF SURROUND.
11. TURF SURROUND TO EXTEND A MINIMUM OF 600 mm ON ALL SIDES OF METER BOX.
12. GEOTEXTILE FABRIC TO BE LAID UNDERNEATH METER BOX TAPED EACH SIDE AND AROUND PIPE TO PREVENT INGRESS OF SAND AND SOIL.
13. REFER TO WBB-WAT-1109-2 FOR THE REQUIREMENTS OF THE SUPPLY AND INSTALLATION OF SERVICE CONNECTIONS AND WATER METERS.

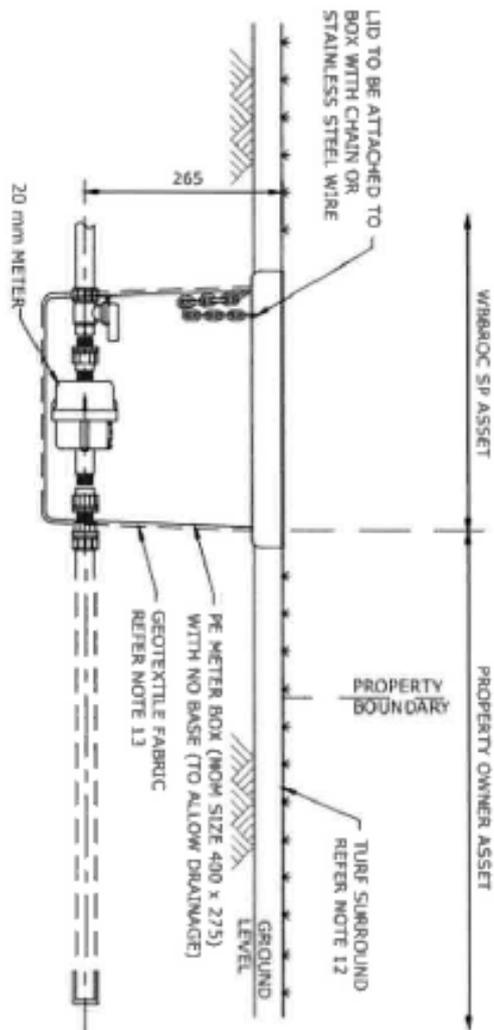

WATER METER DETAIL SECTIONAL VIEW

FITTINGS SCHEDULE

ITEM	DESCRIPTION	NO. OFF
1	DN25 PE100 PN16 PIPE WITH BLUE STRIPE	AS REQ.
2	20 mm x 25 mm FEMALE/PE BRASS LOCKABLE BALL VALVE WITH HANDLE (REFER NOTE 9)	1
3	CONNECTION KIT (COMPRISES OF 2xDN20 BSP M/F BRASS UNIONS)	1
4	DN20 METER WITH DUAL CHECK VALVES (REFER NOTE 1)	1
5	DN25 PE TO DN20 MALE BRASS OR PLASTIC MECHANICAL CONNECTOR	1
6	PE METER BOX WITH LID (REFER NOTE 9)	

**WATER SUPPLY STANDARD DRAWING**

REV. NO.	DATE	DESCRIPTION	AUTH.
A	27/06/2017	ISSUED FOR WBB-WAT-1108-3 (WATER METER DETAIL)	

WATER SUPPLY STANDARD DRAWING	PROPERTY SERVICES	WATER SUPPLY STANDARD DRAWING	BRC	FCRC	GRC	NBRC	SBRC	
POTABLE SERVICE CONNECTION	20mm DOMESTIC SERVICE	METER BOX DETAILS	WBB-WAT-1108-3		NOT TO SCALE			A